



29-JAN-2004 DGN File: N:\Ead\Standard Drawings\Imperial\Approved\Change7\Approved\SL03.dgn

UNDERGROUND SERVICE PEDESTAL

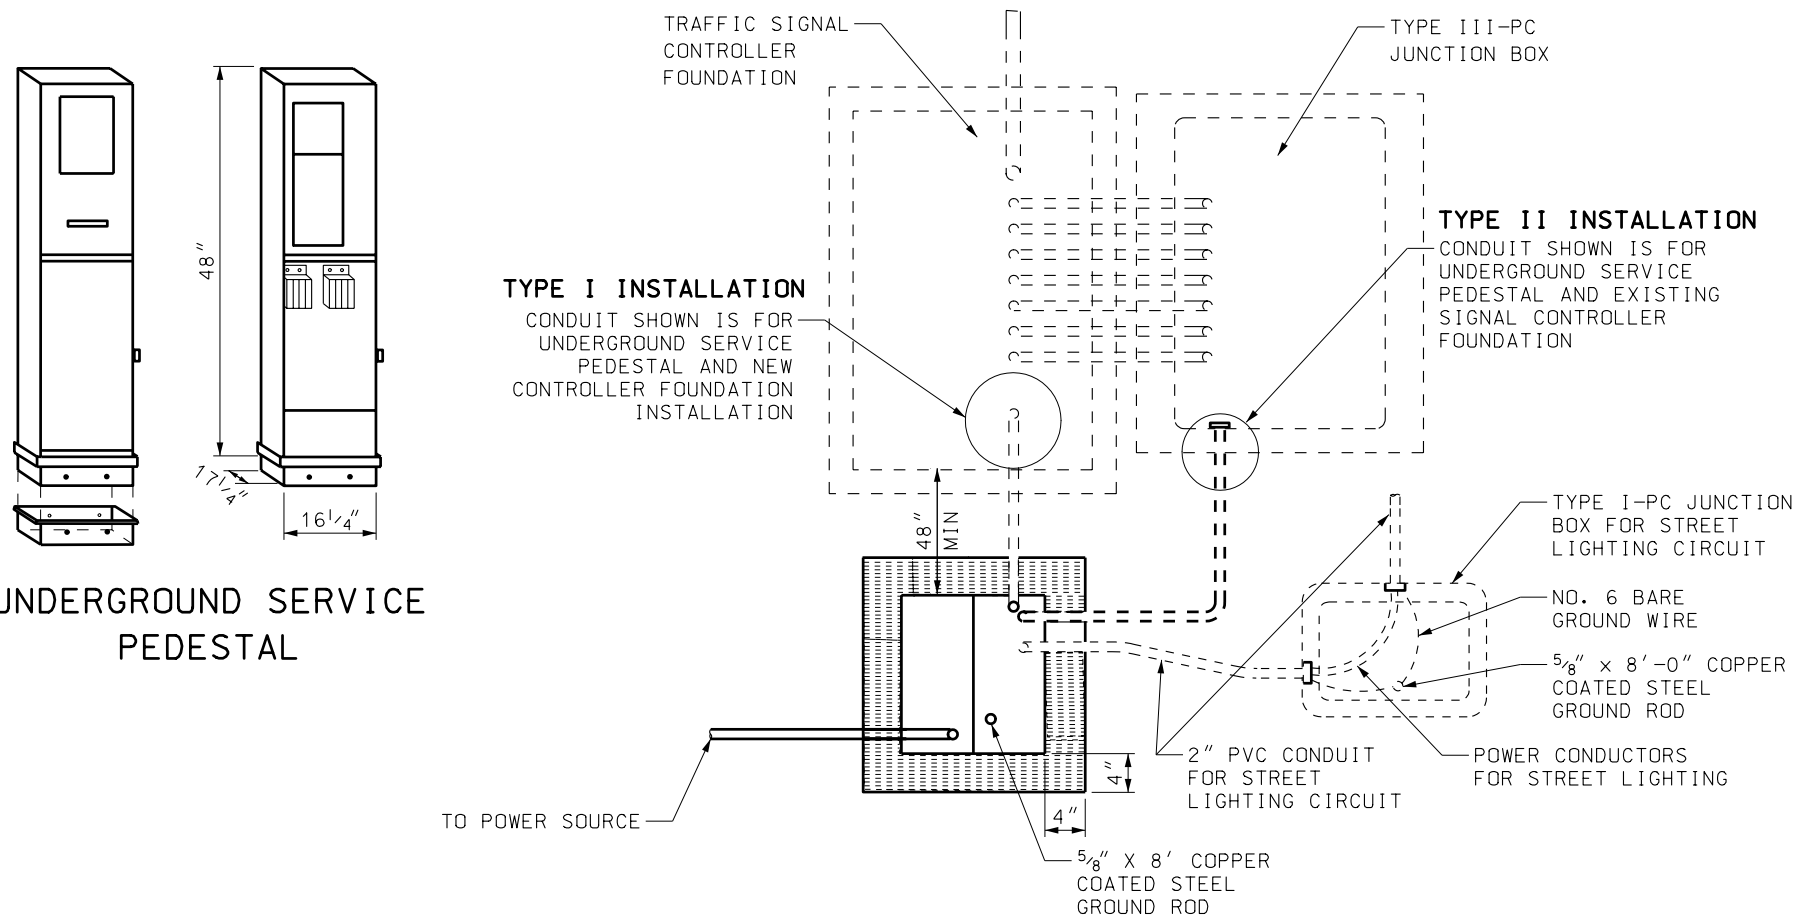

NOTES:

1. LOCATE SERVICE PEDESTAL ON EITHER SIDE OF CONTROLLER FOUNDATION AS SPECIFIED. LOCATION MAY BE MODIFIED TO BEST SUIT FIELD CONDITIONS PER RESIDENT ENGINEER APPROVAL.
2. INCLUDE METER SOCKET WITH TEST BLOCK (SAFETY SOCKET) REQUIRED FOR CIRCUIT BREAKERS.
3. PROVIDE UNDERGROUND SERVICE PEDESTAL:
 - A. RATED 100 AMP AT 120/240 VOLTS.
 - B. PROVIDE FOR SIX FULL SIZE POLES (INCLUDING MAINS) FOR BOTH METERED AND UN-METERED CIRCUIT BREAKER INTERIORS.
 - C. USE PLUG-IN CIRCUIT BREAKERS.
 - D. USE DETACHABLE BASE FOR PRE-INSTALLATION IN CONCRETE FOUNDATION.
 - E. SECURE PIANO HINGED DOORS WITH MASTER PADLOCK NO. P-848

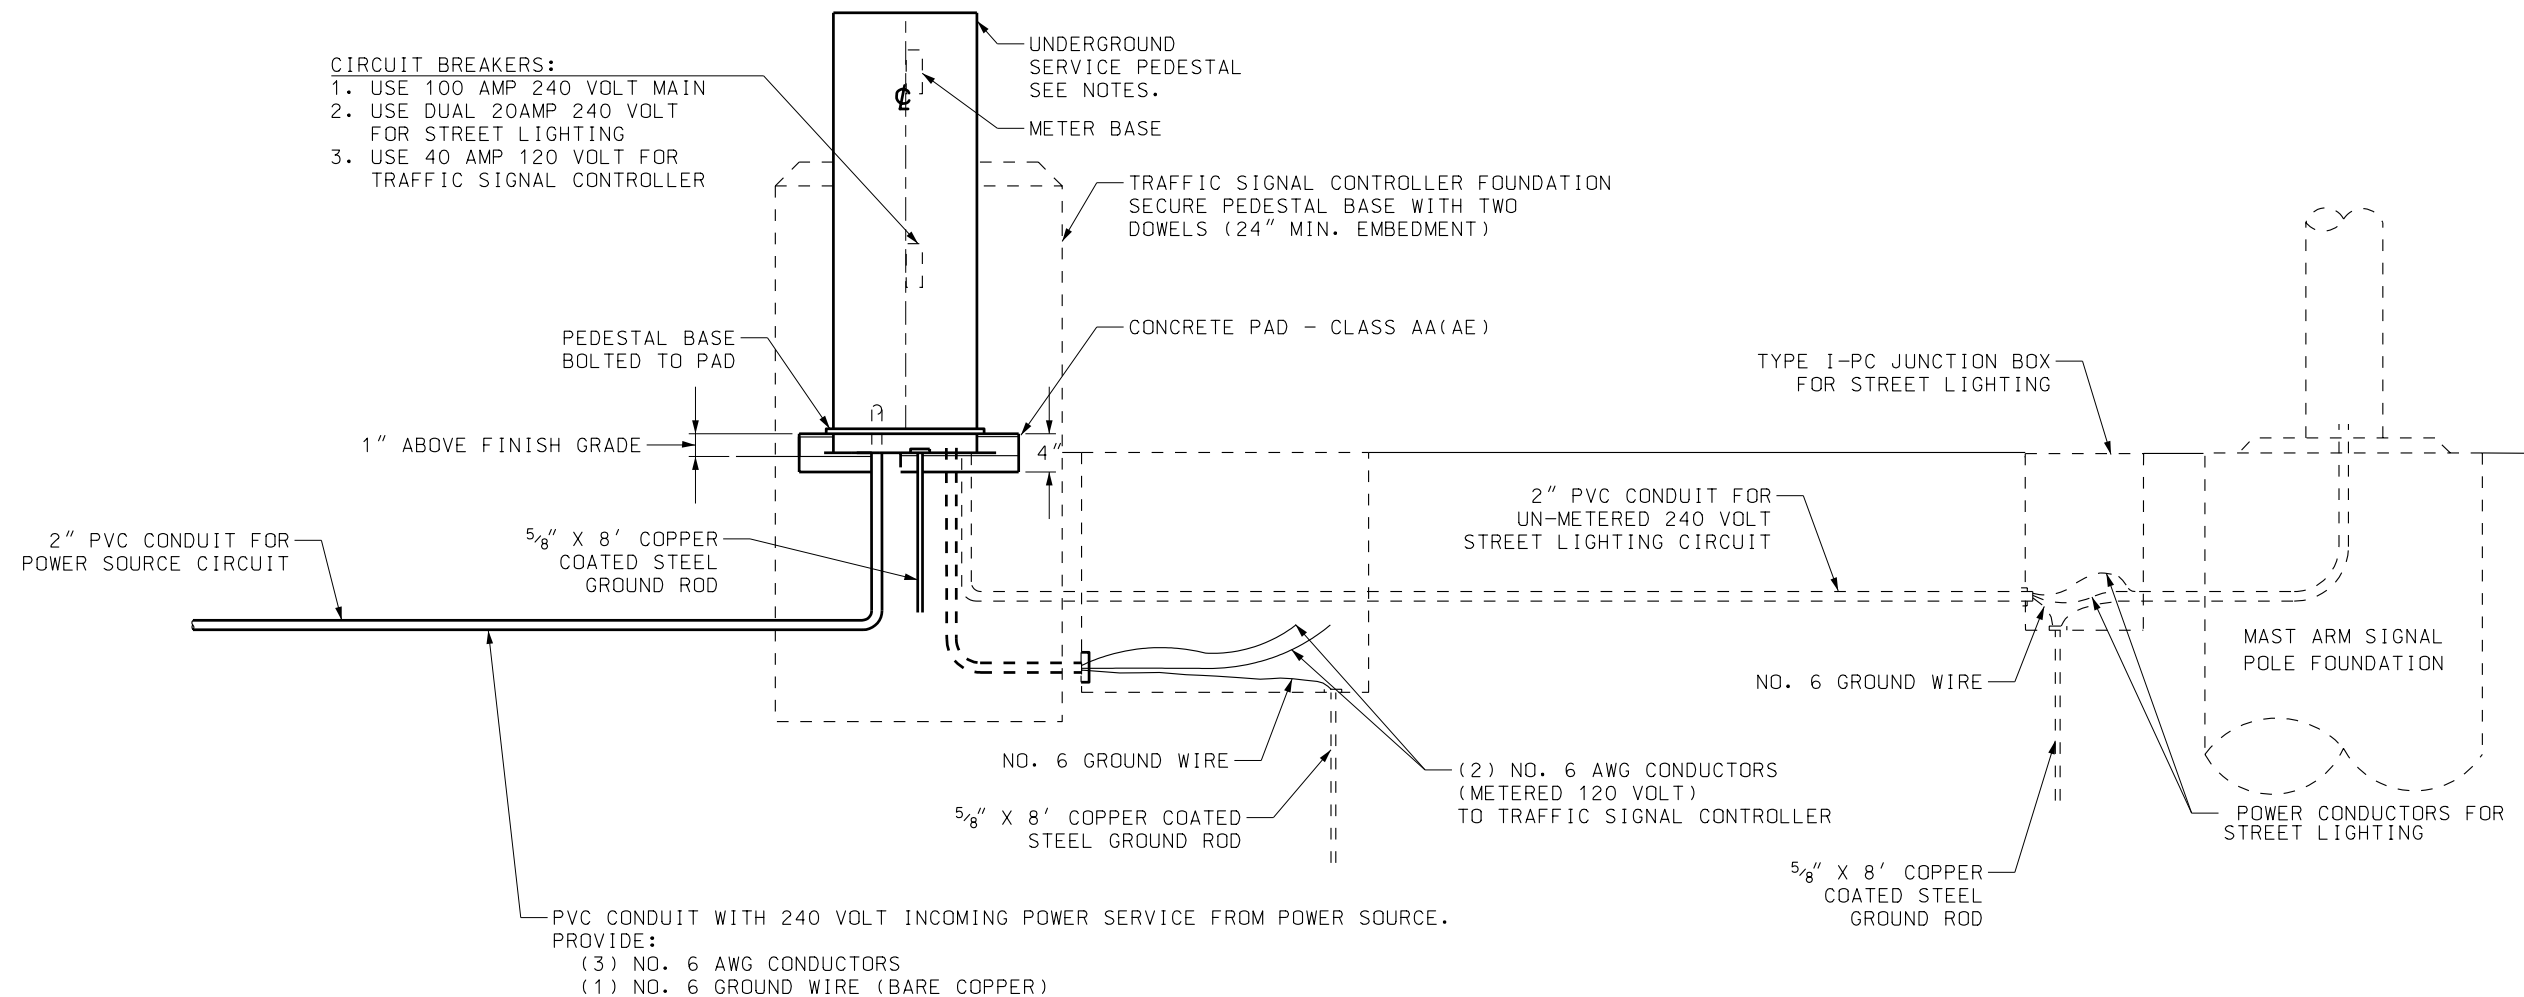

UTAH DEPARTMENT OF TRANSPORTATION
STANDARD DRAWINGS FOR ROAD AND BRIDGE CONSTRUCTION
SALT LAKE CITY, UTAH

UNDERGROUND SERVICE PEDESTAL DETAIL

STD DWG
SL 3

REVISIONS
1 12/18/03 LM ENTIRE DRAWING MODIFIED.

RECOMMENDED FOR APPROVAL
CHAIRMAN STANDARDS COMMITTEE
APPROVED
DEPUTY DIRECTOR

DEC.18.2003 DATE
DEC.18.2003 DATE

STANDARD DRAWING TITLE

REMARKS